


SPECIFIC NOTES (APPLY TO DRAWING E3.4 WHERE INDICATED)

- 1 (3) - 4" PVC CONDUITS, (1) FOR WESTNET AND (2) FOR ANTENNA.
- 2 WALL-MOUNTED JUNCTION BOX AT 48 INCHES ABOVE FINISHED FLOOR FOR CAMERA INSTALLATION. EXTEND 3/4 INCH CONDUIT FROM RECESSED OUTLET BOX TO THE ACCESSIBLE CEILING SPACE ABOVE. ELECTRICAL CONTRACTOR SHALL COORDINATE EXACT LOCATION AND MOUNTING HEIGHT W/ THE COUNTY CONSTRUCTION REPRESENTATIVE PRIOR TO ROUGH-IN. CAMERA INSTALLATION FURNISHED & INSTALLED BY OTHERS.
- 3 CEILING-MOUNTED JUNCTION BOX FOR MICROPHONE. ELECTRICAL CONTRACTOR SHALL COORDINATE EXACT LOCATION W/ THE COUNTY CONSTRUCTION REPRESENTATIVE PRIOR TO ROUGH-IN. MICROPHONE INSTALLATION FURNISHED & INSTALLED BY OTHERS.
- 4 WALL-MOUNTED JUNCTION BOX AT 6 FT 6 INCHES ABOVE FINISHED FLOOR FOR A/V USE. EXTEND 3/4 INCH CONDUIT FROM RECESSED OUTLET BOX TO THE ACCESSIBLE CEILING SPACE ABOVE. ELECTRICAL CONTRACTOR SHALL COORDINATE EXACT LOCATION AND MOUNTING HEIGHT W/ THE COUNTY CONSTRUCTION REPRESENTATIVE PRIOR TO ROUGH-IN. CAMERA INSTALLATION FURNISHED & INSTALLED BY OTHERS.

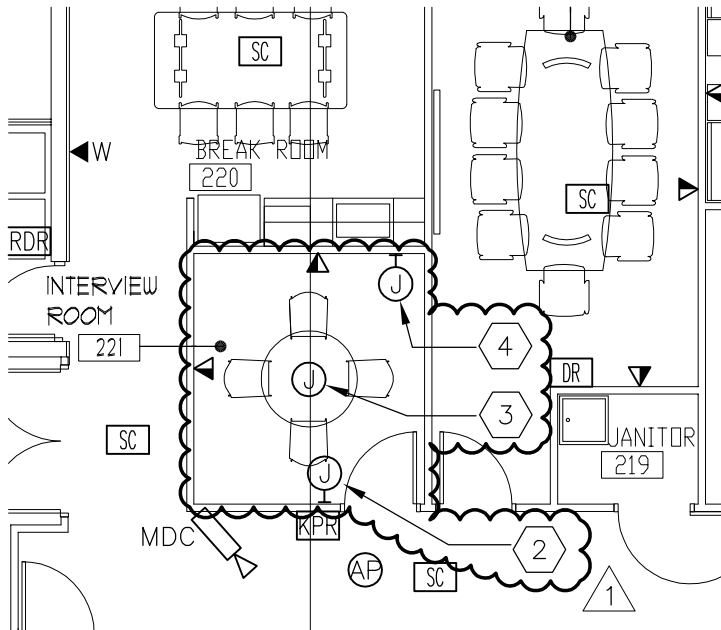

REFER TO DRAWINGS: E-3.4

ADDENDUM REVISION

**BRAMBLETON PUBLIC SAFETY CENTER
BELMONT RIDGE ROAD
BRAMBLETON, VIRGINIA**

BIGNELL/WATKINS/HASSER ARCHITECTS
ONE PARK PLACE, SUITE 250 ANNAPOLIS, MARYLAND 21401



**SCHLENGER / PITZ
& ASSOCIATES, INC.**
Consulting Engineers

15 West Aylesbury Road, Timonium, Maryland 21093
Phone 410.561.1337
Fax 410.561.1446
WWW.SPAENGINEERS.COM
© Copyright 2011 Schlenger/Pitz & Associates, Inc.

DATE: 04/27/2011

SCALE: NOT TO SCALE

DWG. NO:
SKE-34-1